

1883

PROJECT NAME LOCATION ARCHITECT ENGINEER	
CONTRACTOR	
SUBMITTED BY	
	NIT SUMMARY
Quantity	
Unit Designation	
Model No.	
Total Cooling	
Sensible Cooling	
Air Ent. Evaporator	
Air Lvg. Evaporator	
Heating Input	
Heating Output	
CFM/ESP	
EER/SEER	
Electrical	
Minimum Ampacity	
MinMax. Breaker	
Net Unit Weight	
Accessory	
Catalog Form Number	
ACCESSORIES:	NOTES:

Endeavor® Line RF1PZ Air Handlers Nominal Sizes: 1.5 to 3 Ton [5.0 to 16.3 kW]

JOB NAME		 LOCATION
CONTRACTOR		ORDER NO.
ENGINEER		 UNIT MODEL NO
SUBMITTED FOR	☐ APPROVAL	COIL MODEL NO
DATE		 AIR HANDLER MODEL NO

UNIT DATA

COOLING PERFORMANCE

EFFICIENCY	SEER
TOTAL CAPACITY*	_MBH [kW]
SENSIBLE CAPACITY*	_MBH [kW]
OUTDOOR DESIGN TEMP	°F [°C] DB
TEMP. OF AIR ENTERING EVAPORATOR COIL	_ °F [°C] DB _ °F [°C] WB
POWER INPUT REQUIREMENT (*uses blower motor heat)	

HEATING PERFORMANCE

EFFICIENCY	HSPF
TOTAL CAPACITY*	MBH [kW]
OUTDOOR DESIGN TEMP	°F [°C] DB
TEMP. OF AIR ENTERING EVAPORATOR COIL	°F [°C] DB

SUPPLY AIR BLOWER PERFORMANCE

TAL AIR SUPPLY CFM [L/s]	
TAL RESISTANCE EXTERNAL O UNITIWG	
OWER SPEED RPM	
WER OUTPUT REQUIREMENT BHP	
TOR RATING HP [W]	
WER INPUT REQUIREMENT kW	

ELECTRICAL DATA

POWER SUPPLY	Hz
TOTAL UNIT AMPACITY	AMPS
MINIMUM WIRE SIZE	AWG
MAXIMUM OVERCURRENT FUSES/HACR BREAKER	

CLEARANCES

ACCESS SIDE	24" [609.6 mm]
AIR INLETS	12" [304.8 mm]
ABOVE UNIT	60" [1524 mm]

FEATURES

- Quiet Operation¹: Provided by a cabinet construction with 1.0 inch of foil faced insulation for quieter sound characteristics
- Front or Bottom Return with Aluminum Indoor Coil Design: Are constructed of aluminum fins bonded to internally grooved aluminum tubing and are more corrosion resistant
- Rugged Steel Cabinet Construction: Designed for added strength and versatility
- Most Compact Unit Design Available: All standard air handler models are only 36" [915mm] in height
- Field-installed Auxiliary Heater Kits: Provide exact heat for indoor comfort and include circuit breakers which meet UL and cUL requirements for service disconnect
- Less than 2% Cabinet Air Leakage at 1-inch H₂O: When tested in accordance with AHRAE Standard 193
- [] Designates Metric Conversions


¹Based on manufacturer's air handler offering, and the product's airflow stages, motor type and cabinet insulation. Sound levels are also dependent on air handler location and installation.







RF1PZ

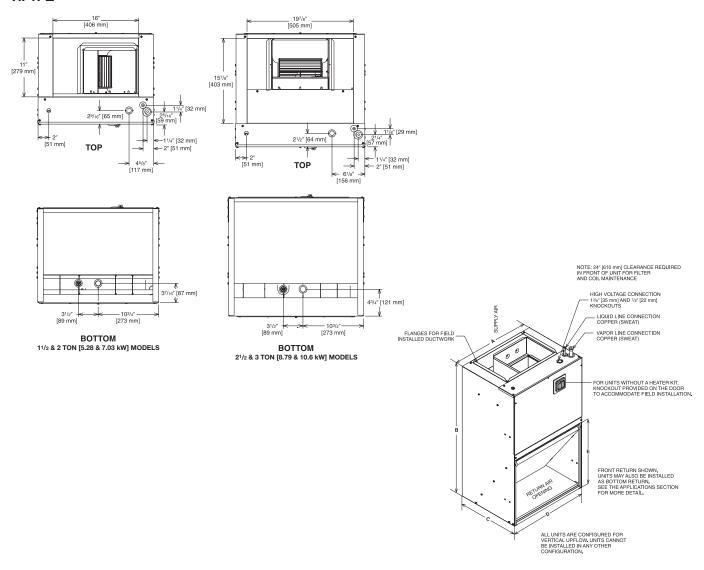

Unit Dimensions

Model	(A) Unit Width	(B) Unit Height	(C) Unit Depth	(D) Return Air Opening Width	(E) Return Air Opening Height	Filter Size in. x in. x in.	Air Flow CFM (Nom.) [L/s]		Unit Weight/ Shipping Weight (Lbs.) [kg]
	In. [mm]	In. [mm] In. [mm]	In. [mm]	In. [mm]	[mm x mm x mm]	Low	High		
RF1PZ1821	211/2 [546.1]	36 [914.4]	17 [431.8]	20 [508.0]	177/16 [442.9]	20 X 20 X 1 [508 X 508 X 25.4]	600 [283]		80 [36] / 90 [41]
RF1PZ2421	211/2 [546.1]	36 [914.4]	17 [431.8]	20 [508.0]	177/16 [442.9]	20 X 20 X 1 [508 X 508 X 25.4]	800 [378]	_	80 [36] / 90 [41]
RF1PZ3024	24 [609.6]	36 [914.4]	21 [533.4]	23 [584.2]	213/8 [542.9]	20 X 25 X 1 [508 X 635 X 25.4]	1000 [472]	_	95 [43] x 105 [48]
RF1PZ3624	24 [609.6]	36 [914.4]	21 [533.4]	23 [584.2]	213/8 [542.9]	20 X 25 X 1 [508 X 635 X 25.4]	1200 [566]	_	95 [43] x 105 [48]

[] Designates Metric Conversions

Before proceeding with installation, refer to installation instructions packaged with each model, as well as complying with all Federal, State, Provincial, and Local codes, regulations, and practices.

5600 Old Greenwood Road Fort Smith, Arkansas 72908

© 2023 Rheem Manufacturing Company. Rheem, Ruud and Friedrich trademarks owned by Rheem Manufacturing Company. "In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice."

PRINTED IN U.S.A. 8-23 QG FORM NO. X33-1645